

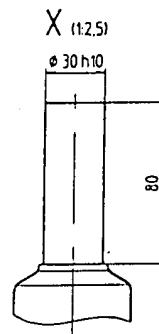
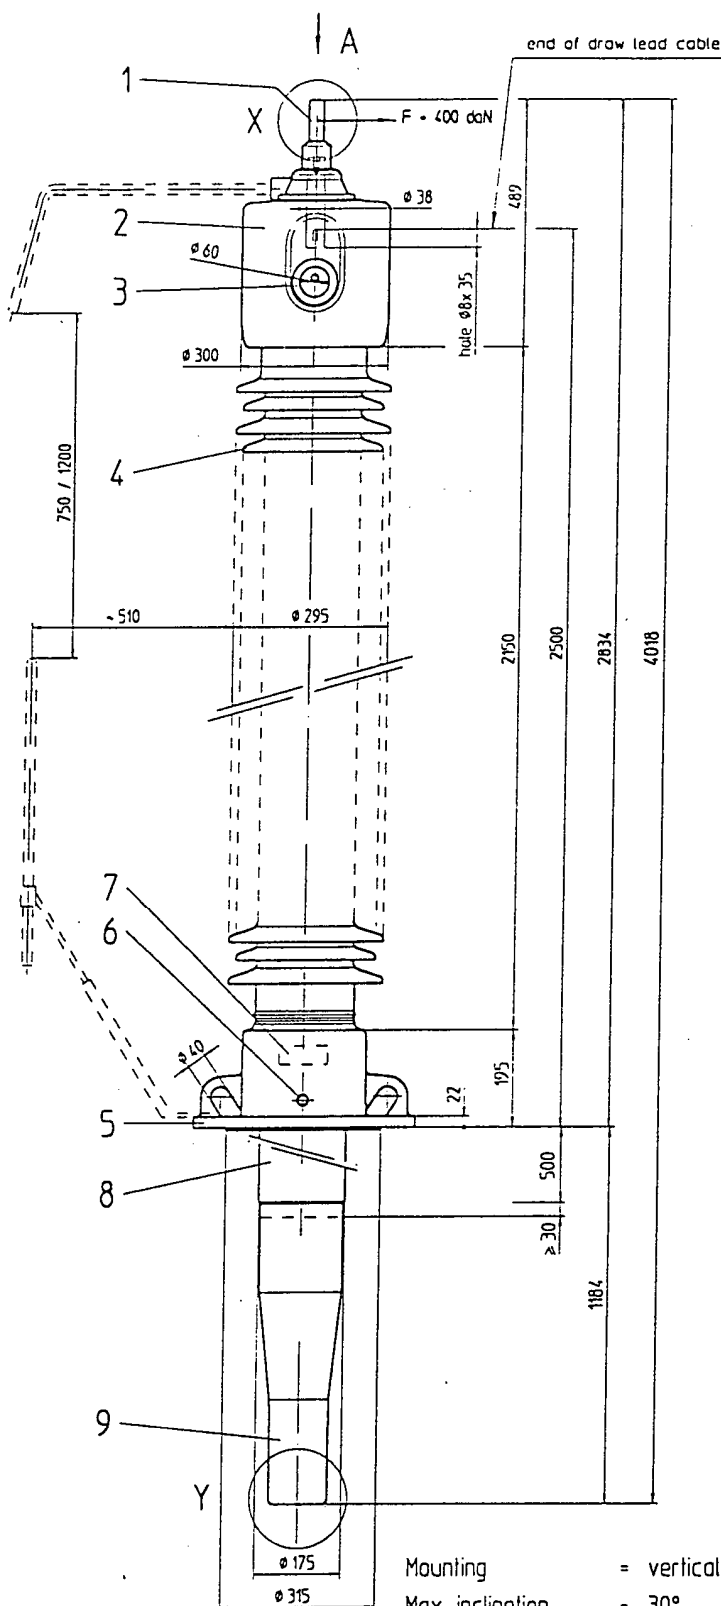
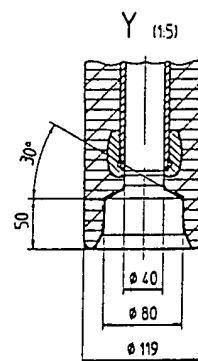


Copyright of this drawing is with the companies
Haeefly Trench AG Basel and F-SILAS. Without
written agreement it's forbidden to make copies of
this drawing as well as forwarding it to third persons

SPARK GAP (only on request)
Radial position in steps of 90° adjustable.



A

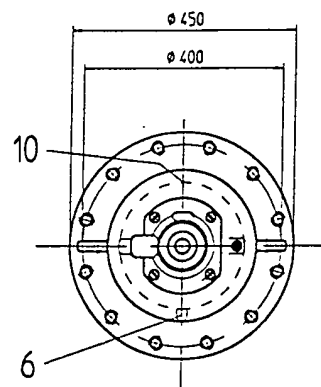

Electrical data

Rated voltage	= 245 kV
Phase to earth voltage	= 142 kV
U _{test} dry and wet 1 mn	= 460 kV
BIL	= 1050 kV
I rated	= 800 A

Standard = IEC 137

Modifications reserved

Item	Designation	Drawn	07.09.95	IFD	Material :	Dimensions :	Mass :	Stock/Req. No :
1	Top terminal (Al)	Checked	07.09.95	IMJ		mm	~ 256 kg	
2	Head (Al-casted)				Title :		General tolerance :	
3	Oil level indicator				Modifications :		List of pieces : KSL	
4	Porcelain insulator	No :	Date :	Visa :	Transformer Bushing		Scale : 1:10	
5	Flange (Al-casted)	02	26.09.96	IFD	Type COT 1050- 800		HAEFELY TRENCH	
6	Test tap	Checked	26.09.96	IMJ	Outline drawing (S) L4-500		Object code :	
7	Rating plate				Slack/Req. No :			
8	Ground sleeve (Al)				Substitute for :			
9	Epoxy insulator				Substituted by :			
10	Air escape screw							

3-417358 Z